



TOP VIEW  
SCALE: 1/80

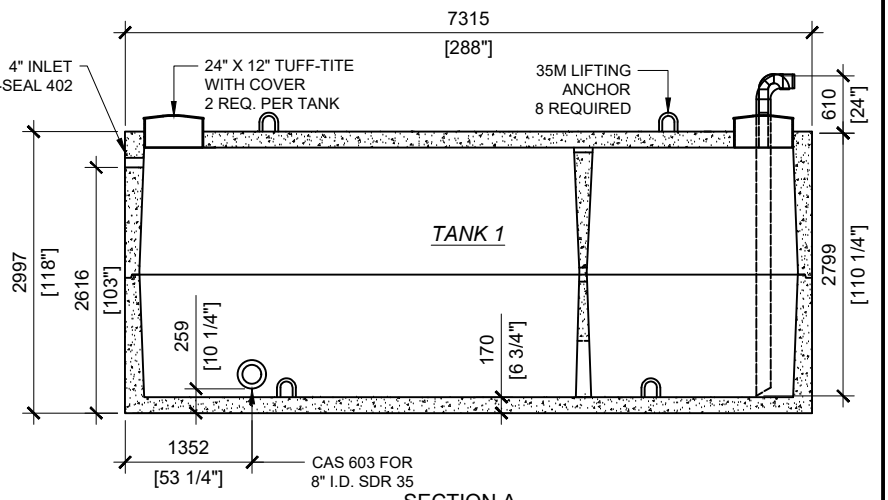

SECTION A  
SCALE: 1/80

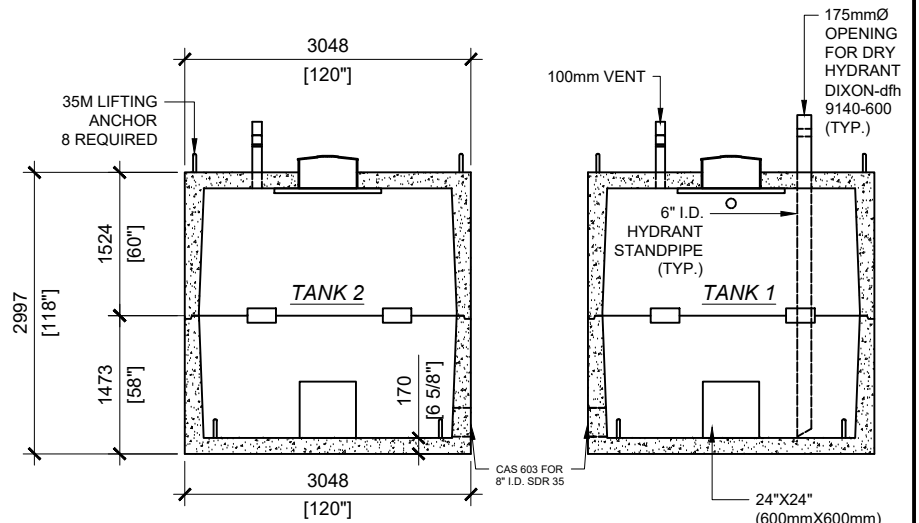

SECTION B  
SCALE: 1/80

**GENERAL NOTES:**

1. UNITS ARE SEALED WITH BUTYL TAPE AT THE JOINTS
2. CONTRACTOR TO ENSURE CRANE IS ON-SITE TO OFFLOAD AND SET TANK
3. EXCAVATION MUST BE READY, SAFE AND ACCESSIBLE FOR UNLOADING FROM THE REAR OF THE TRUCK.
4. MIN OVERHEAD CLEARANCE OF 18FT IS REQUIRED
5. ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT
6. MAXIMUM BURIAL DEPTH = 1 METRE IN FIRM SOIL AWAY FROM ANY VEHICULAR TRAFFIC
7. MULTIPLE TANKS CAN BE CONFIGURED UPON REQUEST

**\*2-LINKED FIRE WATER TANKS\***



MANUFACTURED:  
OTTAWA, ON  
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI  
AIR ENTRAINMENT: 6-8%  
REINFORCEMENT: MEETS G30.14-M1983

CSA APPROVED  
WEIGHT: 47,000lbs / 21,000kg (TOP)  
47,000lbs / 21,000kg (BOTTOM)  
PER TANK  
MEETS CAN/CSA-B66

DRAWN BY:  
S.RIMLAND  
DATE:  
JAN/2019

**45500 LITRES**  
10000 IMPERIAL GALLON

10,000 IMPERIAL GALLON / 45,500 LITRES