



TOP VIEW SCALE:1/80

GENERAL NOTES:

1. CAS 603 - CAST CLOSE AS POSSIBLE TO THE BOTTOM OF TANK
2. CONCRETE TO BE 45MPa/6,500 P.S.I.
3. MAXIMUM BURIAL DEPTH = 1 METRE IN FIRM SOIL AWAY FROM ANY VEHICULAR TRAFFIC

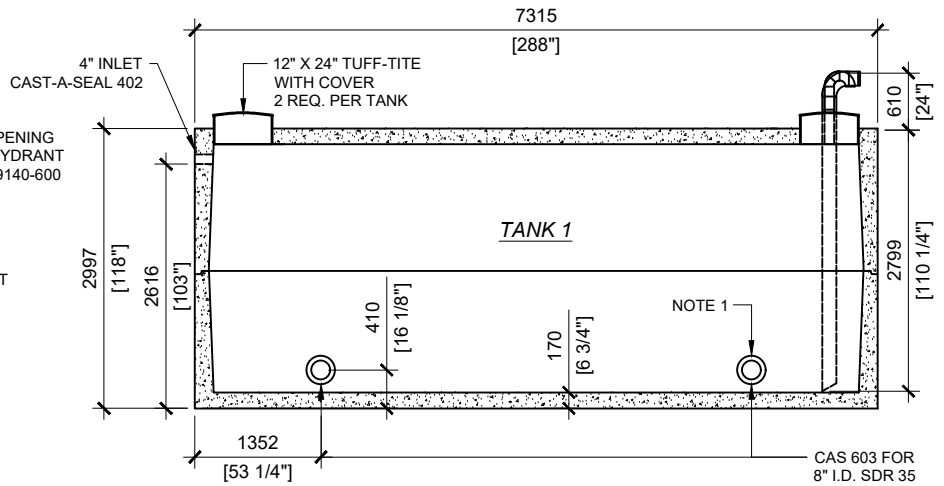

SECTION A SCALE:1/80

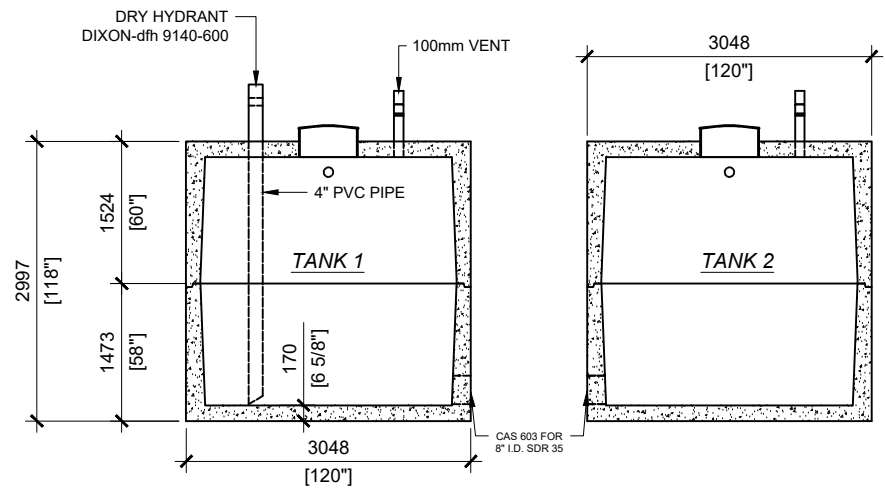

SECTION B SCALE:1/80

2-NESTED FIRE WATER TANKS



MANUFACTURED:
OTTAWA, ON
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI
AIR ENTRAINMENT: 6-8%
MEETS CAN/CSA-B66-00
REINFORCEMENT: MEETS G30.14-M1983

CSA APPROVED
WEIGHT: 47,000lbs / 21,000kg (TOP)
47,000lbs / 21,000kg (BOTTOM)
PER TANK

DRAWN BY:
S.RIMLAND
DATE:
JAN/2018

45500 LITRES
10000 IMPERIAL GALLON

10,000 IMPERIAL GALLON / 45,500 LITRES