


TOP VIEW
SCALE:1/30

SECTION B
SCALE:1/30

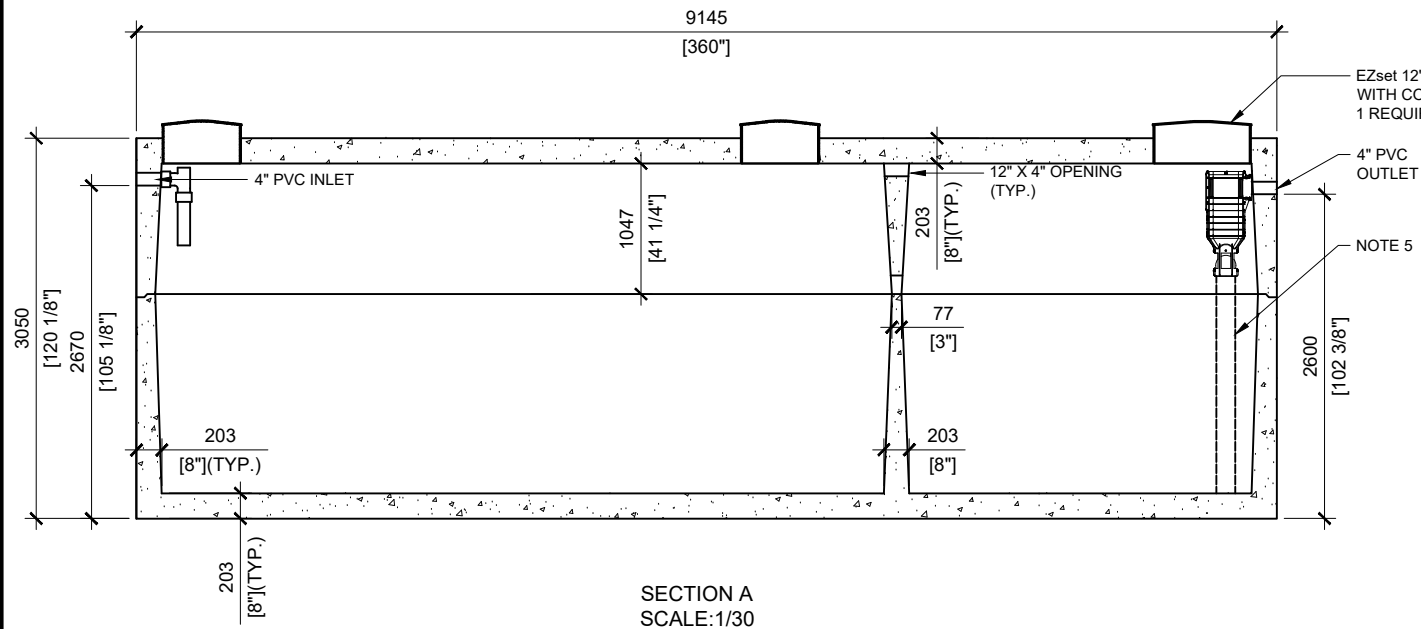

SECTION A
SCALE:1/30

GENERAL NOTES:

1. CONCRETE TO BE 45MPa/6,500 P.S.I.
2. REINFORCEMENT TO CONFORM TO CSA-G30.12-400Pa
3. BURIAL DEPTH: 30"
4. REINFORCEMENT
TANK: 20M @ 150 O/C BOTH WAYS
LID: 20M @ 150 O/C BOTH WAYS
5. 4" PVC SUPPORT PIPE FOR EFFLUENT FILTER NOT PROVIDED



MANUFACTURED:
OTTAWA, ON
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI
AIR ENTRAINMENT: 6-8%
MEETS CAN/CSA-B66-00
REINFORCEMENT : STEEL TO CSA CAN
A23.1 /A23.3 G30.18 Fy=400MPa

CPA CERTIFIED
WEIGHT: 63,150lbs/28,645kg (TOP)
81,625lbs/37,025kg (BOTTOM)

DRAWN BY:
S.RIMLAND
DATE:
JAN / 2018

68200 LITRES
15000 IMPERIAL GALLON
SEPTIC TANK
15,000 IMPERIAL GALLON / 68,200 LITRES