



SECTION A
SCALE: 1/90

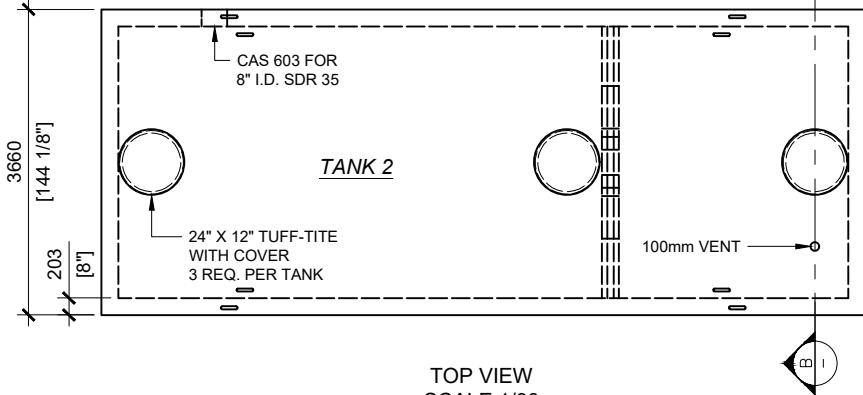

TOP VIEW
SCALE: 1/90

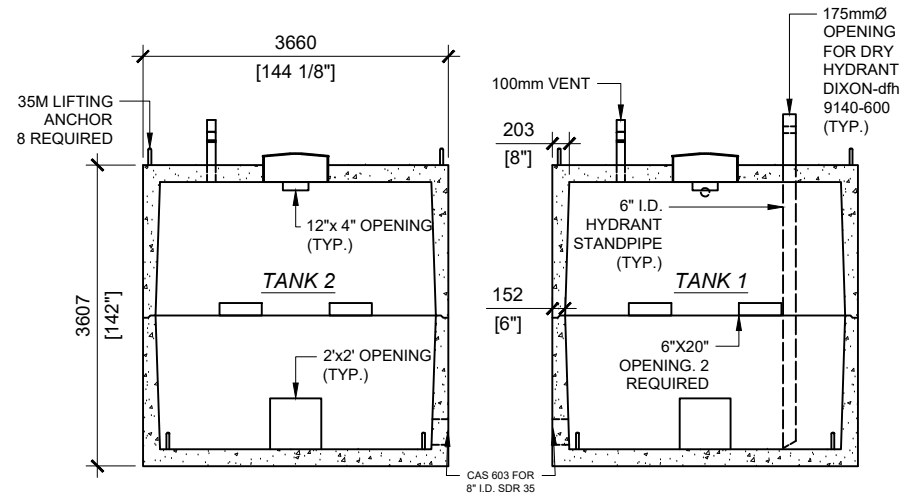

SECTION B
SCALE: 1/90

2-LINKED FIRE WATER TANKS

GENERAL NOTES:

1. UNITS ARE SEALED WITH BUTYL TAPE AT THE JOINTS
2. CONTRACTOR TO ENSURE CRANE IS ON-SITE TO OFFLOAD AND SET TANK
3. EXCAVATION MUST BE READY FOR INSTALL
4. MIN OVERHEAD CLEARANCE OF 18FT IS REQUIRED
5. ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT
6. MAXIMUM BURIAL DEPTH = 1 METRE IN FIRM SOIL AWAY FROM ANY VEHICULAR TRAFFIC
7. MULTIPLE TANKS CAN BE CONFIGURED UPON REQUEST



MANUFACTURED:
OTTAWA, ON
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI
AIR ENTRAINMENT: 6-8%
REINFORCEMENT : STEEL TO CSA CAN
A23.1 /A23.3 G30-18 Fy=400MPa

WEIGHT: 81,065lbs/36,770kg (TOP)
81,625lbs/37,025kg (BOTTOM)
PER TANK
CPA CERTIFIED
MEETS CAN/CSA-B66

DRAWN BY:
S.RIMLAND

DATE:
JAN/2019

90900 LITRES
20000 IMPERIAL GALLON

20,000 IMPERIAL GALLON / 91,000 LITRES