



TOP VIEW
SCALE: 1/90

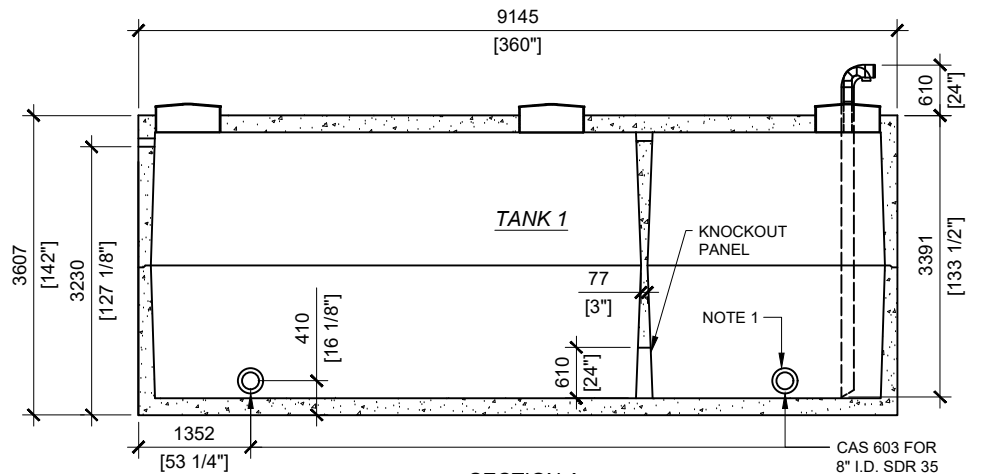

SECTION A
SCALE: 1/90

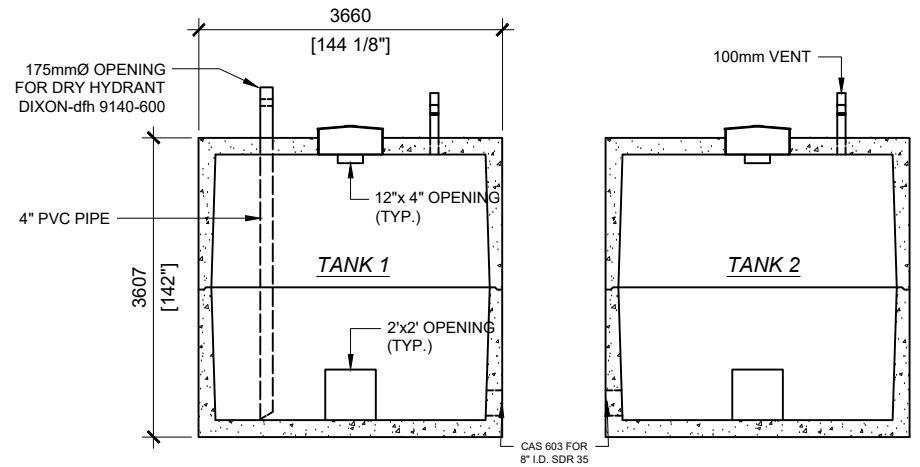

SECTION B
SCALE: 1/90

GENERAL NOTES:

1. CAS 603 - CAST CLOSE AS POSSIBLE TO THE BOTTOM OF THE TANK
 2. CONCRETE TO BE 45MPa/6,500 P.S.I.
 3. REINFORCEMENT TO CONFORM TO CSA-G30.12-400Pa
 4. BURIAL DEPTH: 30"
 5. REINFORCEMENT
- TANK: 20M @ 150 O/C BOTH WAYS
LID: 20M @ 150 O/C BOTH WAYS

2-NESTED FIRE WATER TANKS



MANUFACTURED BY:
OTTAWA, ON
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI
AIR ENTRAINMENT: 6-8%
MEETS CAN/CSA-B66-00
REINFORCEMENT: STEEL TO CSA CAN
A23.1 /A23.3 G30.18 Fy=400MPa

CPA CERTIFIED
WEIGHT: 81,065lbs/36,770kg (TOP)
81,625lbs/37,025kg (BOTTOM)
PER TANK

DRAWN BY:
S.RIMLAND
DATE:
JAN/2018

90900 LITRES
20000 IMPERIAL GALLON

20,000 IMPERIAL GALLON / 91,000 LITRES