



TOP VIEW
SCALE: 1/60

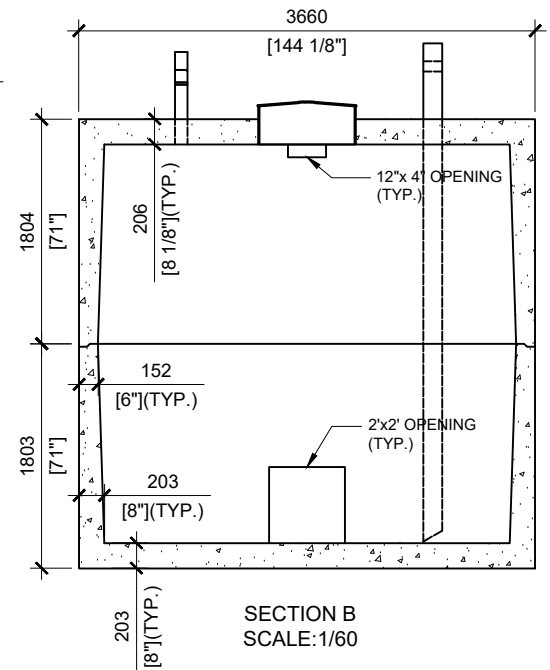

SECTION B
SCALE: 1/60

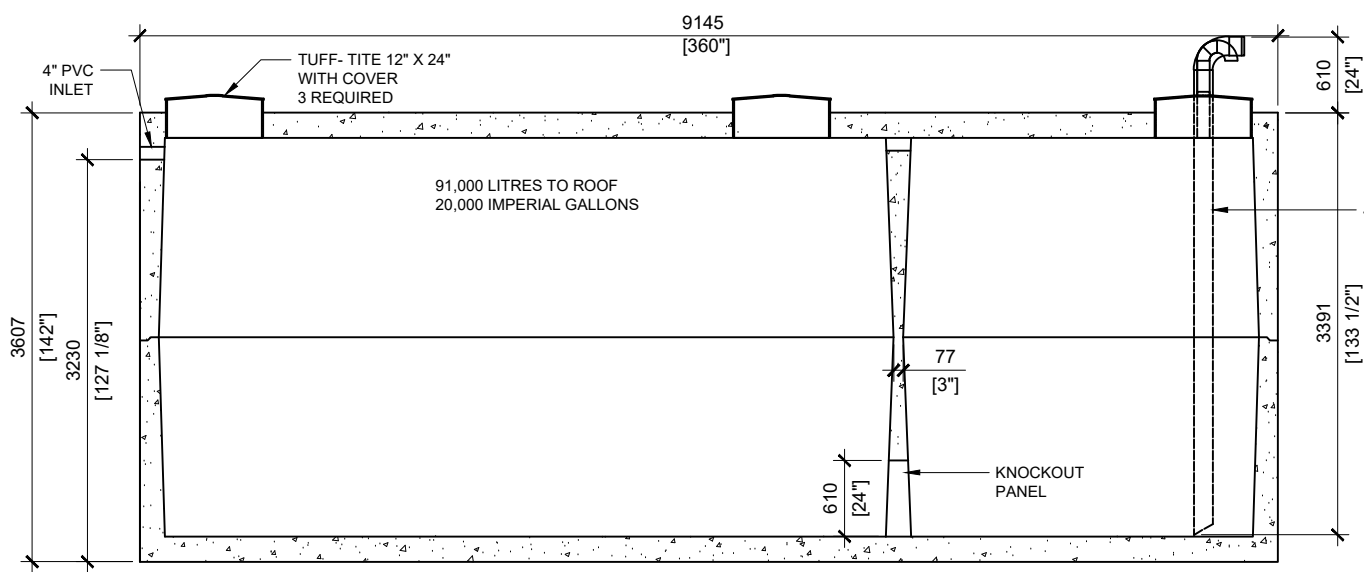

SECTION A
SCALE: 1/60

GENERAL NOTES:

1. CONCRETE TO BE 45MPa/6,500 P.S.I.
 2. REINFORCEMENT TO CONFORM TO CSA-G30.12-400Pa
 3. BURIAL DEPTH: 30"
 4. REINFORCEMENT
- TANK: 20M @ 150 O/C BOTH WAYS
LID: 20M @ 150 O/C BOTH WAYS

SINGLE FIRE WATER TANK



MANUFACTURED:
OTTAWA, ON
1-800-655-3430

CONCRETE: 45MPa / 6,500PSI
AIR ENTRAINMENT: 6-8%
MEETS CAN/CSA-B66-00
REINFORCEMENT : STEEL TO CSA CAN
A23.1 /A23.3 G30.18 Fy=400MPa

CPA CERTIFIED
WEIGHT: 77,100lbs/34,970kg (TOP)
77,700lbs/35,244kg (BOTTOM)

DRAWN BY:
S.RIMLAND
DATE:
JAN/2018

90900 LITRES
20000 IMPERIAL GALLON

20,000 IMPERIAL GALLON / 91,000 LITRES