



GENERAL NOTES:

- 1. DELIVERY IS MADE BY CRANE-EQUIPPED TRUCKS
- 2. EXCAVATION MUST BE READY, SAFE AND ACCESSIBLE FOR UNLOADING FROM THE REAR OF THE TRUCK.
- 3. MIN OVERHEAD CLEARANCE OF 18FT (5.5 METRES) IS REQUIRED
- 4. ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT (I.E. SPREADER BAR)
- 5. FOR INSTALLATIONS ON STONE BEDDING, THE ALLOWABLE BEARING PRESSURE AT THE UNDERSIDE OF THE VAULT BOX SECTION SHALL BE A MINIMUM OF 75KPA (S.L.S.)
- 6. THIS BEARING PRESSURE IS ASSUMED AND SHALL BE CONFIRMED BY A QUALIFIED GEOTECHNICAL ENGINEER PRIOR TO INSTALLATION OF THE VAULT
- 7. THE TRANSFORMER SHOULD BE UNIFORMLY DISTRIBUTED AND THE EDGE OF THE TRANSFORMER BASE SHALL BE SET WITHIN 150MM OF THE INTERIOR DIMENSIONS FOR THE BASE

TOP VIEW SCALE:1/30

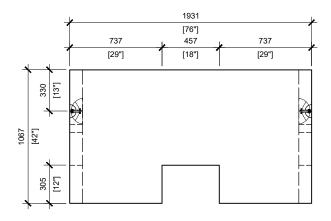

FRONT VIEW SCALE:1/30

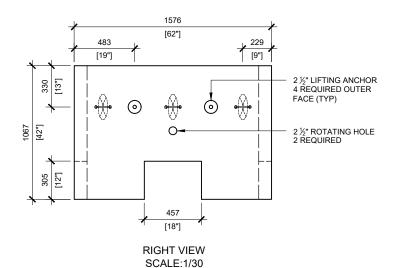



MANUFACTURED: BROOKLIN, ON 1-800-655-3430 CONCRETE: 35MPa / 5,000PSI AIR ENTRAINMENT: 5-8%

REINFORCEMENT: STEEL TO CSA CAN A23.1 / A23.3. G30.18 Fy=400MPa WEIGHT:

BCP111C -3,500lbs / 1,590kg

DRAWN BY: N.CHAN BCP111C

DATE: JUL/2020 FOUNDATION FOR PADMOUNT TRANSFORMER