




BCP111P TOP VIEW
SCALE:1/40

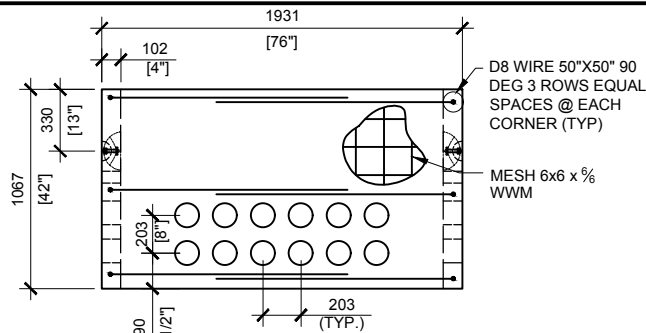


BCP111P FRONT VIEW.
SCALE:1/40

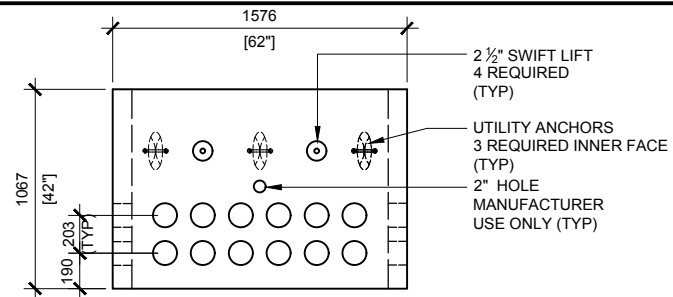



BCP111P RIGHT VIEW
SCALE:1/40

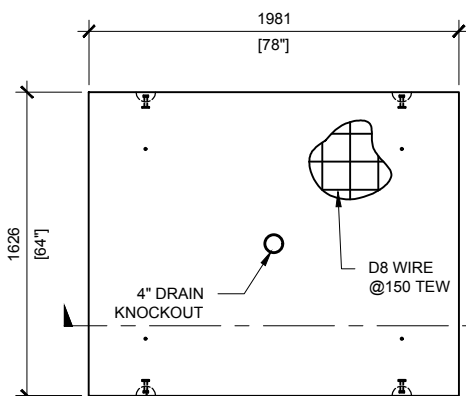

BCP111B TOP VIEW
SCALE:1/40

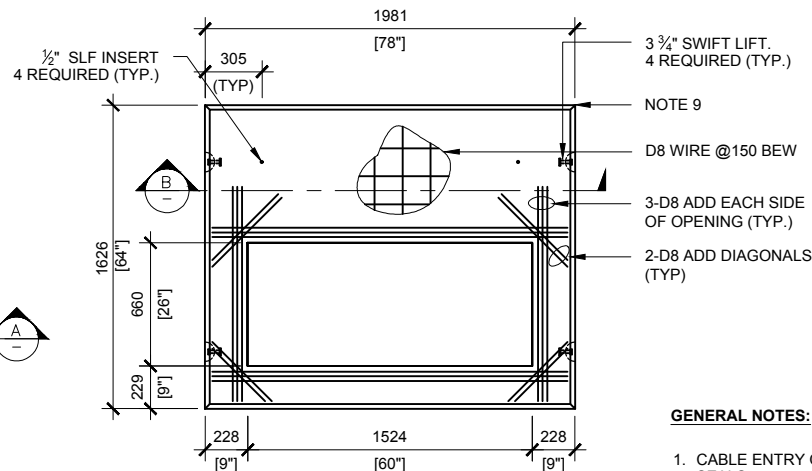

BCP111TGW TOP VIEW
SCALE:1/40

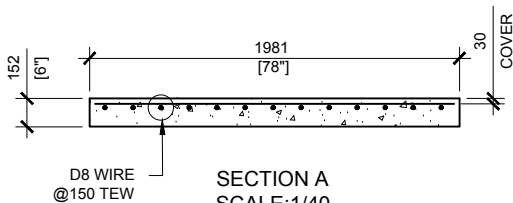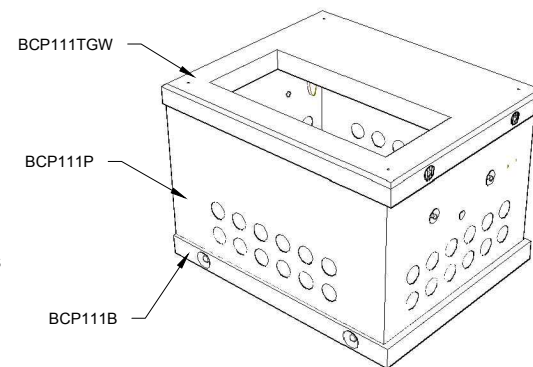

SECTION A
SCALE:1/40



SECTION B
SCALE:1/40

GENERAL NOTES:

- CABLE ENTRY OPENINGS - 4 3/4\" PVC SEALS
 - DELIVERY IS MADE BY CRANE-EQUIPPED TRUCKS
 - EXCAVATION MUST BE READY, SAFE AND ACCESSIBLE FOR UNLOADING FROM THE REAR OF THE TRUCK.
 - MIN OVERHEAD CLEARANCE OF 18FT IS REQUIRED
 - ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT (I.E. SPREADER BAR)
 - FOR INSTALLATIONS ON STONE BEDDING, THE ALLOWABLE BEARING PRESSURE AT THE UNDERSIDE OF THE VAULT BOX SECTION SHALL BE A MINIMUM OF 75kPa (S.L.S.)
 - THIS BEARING PRESSURE IS ASSUMED AND SHALL BE CONFIRMED BY A QUALIFIED GEOTECHNICAL ENGINEER PRIOR TO INSTALLATION OF THE VAULT
 - THE TRANSFORMER SHOULD BE UNIFORMLY DISTRIBUTED AND THE EDGE OF THE TRANSFORMER BASE SHALL BE SET WITHIN 150MM OF THE INTERIOR DIMENSIONS FOR THE BASE
 - TOP EDGES TO HAVE CHAMFER
- MAXIMUM LOAD CAPACITY:**
- MAX. LINEAL LOAD ON TOP SLAB: 15kN/m (UNFACTORED)
 - MAX. EQUIPMENT WEIGHT: 50KN (11,240LBS)



MANUFACTURED:
BROOKLIN, ON
1-800-655-3430

CONCRETE: 35MPa / 5,000PSI
AIR ENTRAINMENT: 6-8%
REINFORCEMENT : STEEL TO CSA CAN
A23.1 / A23.3. G30.18 Fy=400MPa

WEIGHT:
BCP111TGW -1,200lbs / 572kg
BCP111P -3,635lbs / 1,650kg
BCP111B -2,600lbs / 1,120kg

DRAWN BY:
S.RIMLAND
DATE:
AUG/2017

BCP111HO-03

INCLUDES: BCP111TGW/ BCP111P / BCP111B