


TOP VIEW
SCALE:1/40

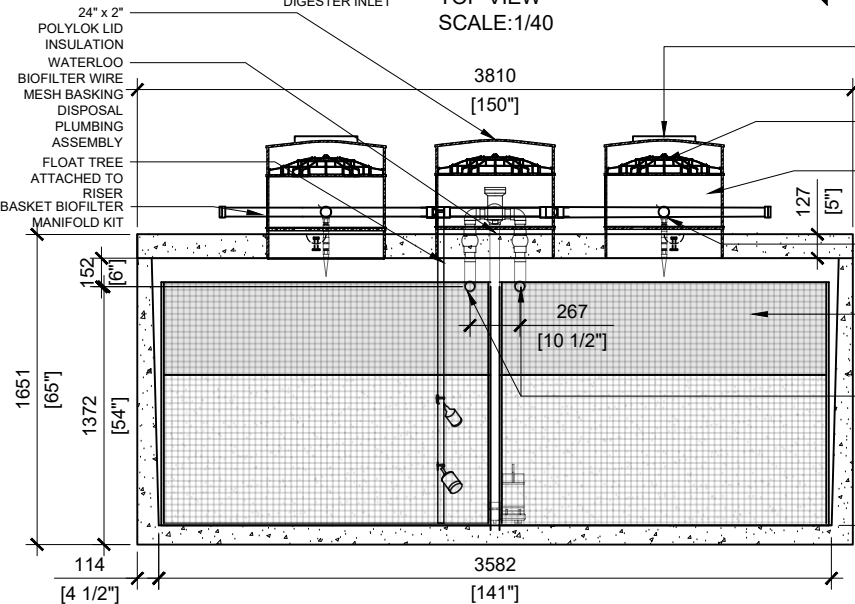


SECTION A
SCALE:1/40

24" x 2" POLYLOK CARBON VENTED LID 2 REQUIRED
 24" POLYLOK SAFETY LID 3 REQUIRED
 24" x 12" POLYLOK RISER 2 REQUIRED
 NOZZLE ASSEMBLY 2 REQUIRED
 WATERLOO BASKET BIOFILTERS 69" DIAM. X 51" HEIGHT 2 REQUIRED (NOTE 8)
 2" OUTLETS USED FOR SYSTEMS OR EQUAL TO 3000 L/DAY

24" x 2" POLYLOK CARBON VENTED LID 2 REQUIRED
 WATERLOO BIOFILTER WIRE MESH BASKING DISPOSAL PLUMBING ASSEMBLY
 24" x 12" POLYLOK RISER W/ ELECTRICAL SPLICE BOX SUPPLIED BY WATERLOO

FLOAT TREE ATTACHED TO RISER

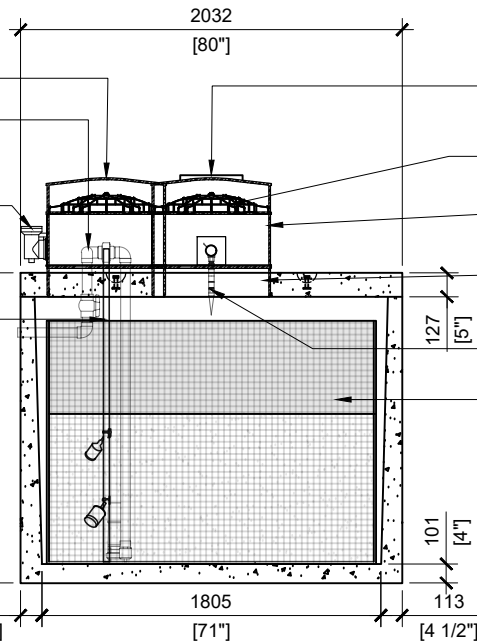

SECTION B
SCALE:1/40

24" x 2" POLYLOK CARBON VENTED LID 2 REQUIRED
 24" POLYLOK SAFETY LID 3 REQUIRED
 24" x 12" POLYLOK RISER 2 REQUIRED
 24" x 6" POLYLOK RISER 6 REQUIRED
 NOZZLE ASSEMBLY 2 REQUIRED
 WATERLOO BASKET BIOFILTERS 69" DIAM. X 51" HEIGHT 2 REQUIRED (NOTE 8)

GENERAL NOTES:

1. UNITS ARE SEALED WITH BUTYL TAPE AT THE JOINTS
2. DELIVERY IS MADE BY CRANE-EQUIPPED TRUCKS
3. EXCAVATION MUST BE READY, SAFE AND ACCESSIBLE FOR UNLOADING FROM THE REAR OF THE TRUCK.
4. MIN OVERHEAD CLEARANCE OF 18FT (5.5 METRES) IS REQUIRED
5. ALL UNITS MUST BE HANDLED WITH PROPER LIFTING EQUIPMENT
6. MAXIMUM BURIAL DEPTH = 1 METRE IN FIRM SOIL AWAY FROM ANY VEHICULAR TRAFFIC
7. CENTER PIPE MANIFOLD LENGTH 56-1/2"
8. BASKET CAPACITY OF - 3000L TO 4000L/DAY



MANUFACTURED:
LINDSAY, ON
1-800-655-3430

CONCRETE: 35MPa at 28 days/5000PSI
 AIR ENTRAINMENT: 5-8%
 REINFORCEMENT: STEEL TO CSA CAN
 A23.1 / A23.3 G30.18 Fy=400MPa

UNIT WEIGHT: 17,821lbs / 8,083kg
 TANK: 12,474lbs / 5,658kg
 LID: 5,347lbs / 2,425kg

DRAWN BY:
PRASHAN

DATE:
JAN/2024

WATERLOO BT-7500

7,500 LITRES